



IGUANA VISIO

Radiators that mirror your style




jaga

Iguana Visio

Dimensions


Product code: VISW

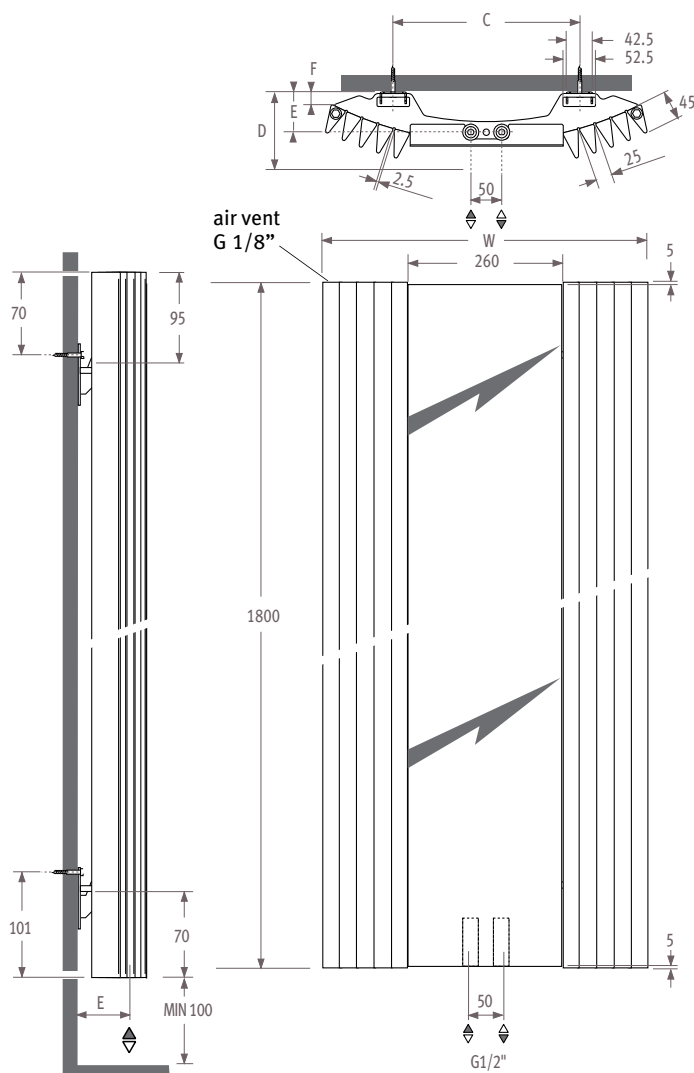

| | W > 519 | 625 | 733 |
|---|---------|-----|-----|
| C | 300 | 400 | 500 |
| D | 107 | 112 | 127 |
| E | 67 | 62 | 77 |
| F | 22 | 30 | 25 |

Connections

Two pipe

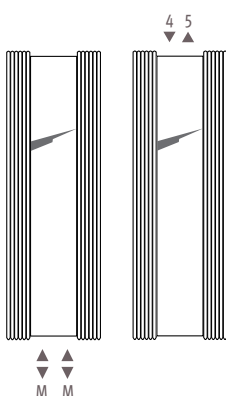

Standard connection Code MM

Top end connection

Code 45 or 54

(1° number > flow)

When ordering a top end connection, no insert pipe should be ordered. Air vents should be positioned on the central heating pipes.

Order code: Specify code 45 or 54 instead of MM - There is no extra charge.

To guarantee the output of the Iguana models and to limit the pressure drop, Jaga recommends the use of tube diameters 16/2, 18/1 or 18/2.



All dimensions in mm

Outputs

Outputs in watts at 75/65/20°C & 55/45/20°C, in accordance with EN442

ORDER CODE: VISW code height length colour connection
180 051 333 /MM (Example order code shown is for a 1800mm high radiator, 510mm long)

| H | | W 510 | 620 | 730 |
|------|----------|-------|------|------|
| 1800 | 75/65/20 | 719 | 1007 | 1294 |
| | 55/45/20 | 361 | 506 | 650 |
| 2000 | 75/65/20 | 751 | 1051 | 1352 |
| | 55/45/20 | 379 | 530 | 682 |
| 2200 | 75/65/20 | 780 | 1092 | 1404 |
| | 55/45/20 | 395 | 552 | 710 |




Supplied as Standard

- Colours: 001 Sandblast grey metallic 301 white or 333 traffic white
- Central connection MM underneath
- Wall fixing
- 2 chrome-plated air vents G 1/8"

Options


Large shelf in beech veneer



| Radiator width > | 290 | 410 | 510 | 620 | 730 | 830 |
|------------------|-----|-----|-----|-----|-----|-----|
| Shelf width | - | 530 | 530 | 540 | 540 | 540 |
| Total depth | - | 289 | 305 | 300 | 315 | 335 |

Order code: 9087.020529 | Order code: 9087.020543


Small shelf in beech veneer



| Radiator width > | 290 | 410 | 510 | 620 | 730 | 830 |
|------------------|-----|-----|-----|-----|-----|-----|
| Shelf width | - | 480 | 480 | 510 | 510 | 510 |
| Total depth | - | 219 | 235 | 230 | 245 | 265 |

Order code: 9087.021480 | Order code: 9087.021512


Towel rail chrome-plated aluminium



| Radiator width > | 290 | 410 | 510 | 620 | 730 | 830 |
|------------------|-----|-----|-----|-----|-----|-----|
| Shelf width | - | 550 | 550 | 660 | 660 | 660 |
| Total depth | - | 188 | 204 | 199 | 214 | 234 |

Order code: 9087.023550 | Order code: 9087.023656

Hat rack chrome-plated aluminium



| Radiator width > | 290 | 410 | 510 | 620 | 730 | 830 |
|------------------|-----|-----|-----|-----|-----|-----|
| Shelf width | - | 550 | 550 | 660 | 660 | 660 |
| Total depth | - | 188 | 204 | 199 | 214 | 234 |

Order code: 9087.024550 | Order code: 9087.024656

All dimensions are shown in millimetres



Output measured in accordance with EN442, at a water temperature of 75/65°C and a room temperature of 20°C (ΔT=50).

Connection Sets


The order code of the connection set will be completed with the sleeve coupling code

Set 31

For connection to the wall

Two pipe

| Code | Thermostatic head |
|------------------|-------------------|
| CODE.MW2.MW.1... | white |
| CODE.MW2.MC.1... | chrome |
| CODE.MW2.MB.1... | black |

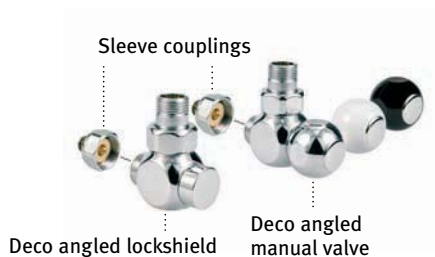

Set 32

For connection to the floor

Two pipe



| Code | Thermostatic head |
|------------------|-------------------|
| CODE.MF2.MW.1... | white |
| CODE.MF2.MC.1... | chrome |
| CODE.MF2.MB.1... | black |




Set 33

For connection to the wall

Two pipe

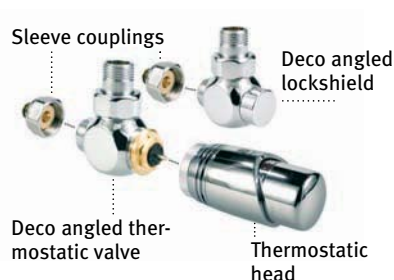

| | |
|------------------|---|
| CODE.JW2.DW.1... |  |
| CODE.JW2.DC.1... |  |



Set 34

For connection to the floor

Two pipe



| | |
|------------------|---|
| CODE.JF2.DW.1... |  |
| CODE.JF2.DC.1... |  |




Set 35

For connection to the wall

Two pipe

| | |
|------------------|---|
| CODE.JH2.DW.1... |  |
| CODE.JH2.DC.1... |  |

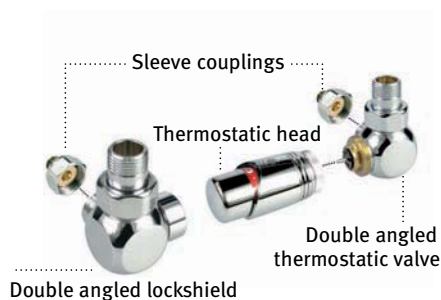

Thermostatic heads

DW



Chrome/ White

DC



Chrome

Set 41


For connection to the wall

Two pipe

CODE.PW3.DW.1...



CODE.PW3.DC.1...

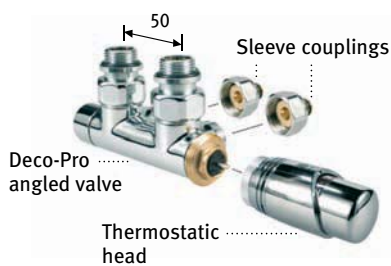

Set 42


For connection to the floor

Two pipe

CODE.PF3.DW.1...



CODE.PF3.DC.1...

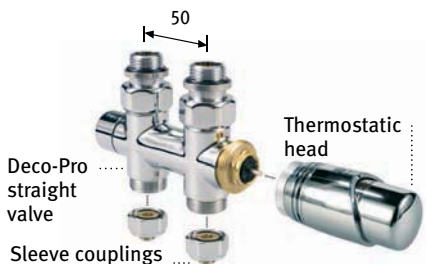

The order code of the connection set will be completed with the sleeve coupling code


Sleeve Couplings

Included in the price of the connection sets

For Jaga valve - M24


For flexible steel or copper tube

| Code | Tube Ø |
|------|--------|
| 110 | 10/1 |
| 112 | 12/1 |
| 114 | 14/1 |
| 115 | 15/1 |
| 116 | 16/1 |
| 118 | 18/1 |

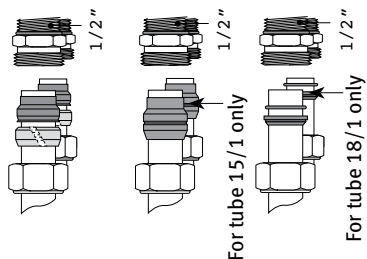


For synthetic tube

| Code | Tube Ø |
|------|--------|
| 212 | 12/2 |
| 214 | 14/2 |
| 219 | 16/1.5 |
| 216 | 16/2 |
| 217 | 17/2 |
| 218 | 18/2 |




For RPE/ALU tube

| Code | Tube Ø |
|------|--------|
| 314 | 14/2 |
| 316 | 16/2 |
| 326 | 16/2.2 |
| 318 | 18/2 |



Steel tube for CH

| Code | Tube Ø |
|------|--------|
| 501 | 1/2" |
| 503 | 3/8" |



Complete ordering code with sleeve couplings according to the material used and diameter of the tube. *The correct type of sleeve coupling is determined by the ordering code of the connection set* Example: COLO. PW2.DW. 32. (insert relevant code from above)

Correction factors

Average correction factors according to EN442 - 75/65/20°C

| TV | TL | TR_20 | 25 | 30 | 35 | 40 | 45 | 50 | 55 | 60 | 65 | 70 | 75 | 80 | 85 |
|-----------|----|-------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 90 | 20 | 0.63 | 0.69 | 0.75 | 0.81 | 0.87 | 0.94 | 1.00 | 1.07 | 1.13 | 1.20 | 1.27 | 1.34 | 1.41 | 1.48 |
| | 24 | 0.54 | 0.59 | 0.65 | 0.71 | 0.77 | 0.83 | 0.90 | 0.96 | 1.03 | 1.09 | 1.16 | 1.23 | 1.29 | 1.36 |
| 85 | 20 | 0.57 | 0.63 | 0.69 | 0.75 | 0.81 | 0.87 | 0.94 | 1.00 | 1.07 | 1.13 | 1.20 | 1.27 | 1.34 | 1.41 |
| | 24 | 0.48 | 0.54 | 0.59 | 0.65 | 0.71 | 0.77 | 0.83 | 0.90 | 0.96 | 1.03 | 1.09 | 1.16 | 1.23 | 1.30 |
| 80 | 20 | 0.51 | 0.57 | 0.63 | 0.69 | 0.75 | 0.81 | 0.87 | 0.94 | 1.00 | 1.07 | 1.13 | 1.20 | | |
| | 24 | 0.43 | 0.48 | 0.54 | 0.59 | 0.65 | 0.71 | 0.77 | 0.83 | 0.90 | 0.96 | 1.03 | 1.09 | | |
| 75 | 20 | 0.46 | 0.51 | 0.57 | 0.63 | 0.69 | 0.75 | 0.81 | 0.87 | 0.94 | 1.00 | 1.07 | | | |
| | 24 | 0.37 | 0.43 | 0.48 | 0.54 | 0.59 | 0.65 | 0.71 | 0.77 | 0.83 | 0.90 | 0.96 | | | |
| 70 | 20 | 0.41 | 0.46 | 0.51 | 0.57 | 0.63 | 0.69 | 0.75 | 0.81 | 0.87 | 0.94 | | | | |
| | 24 | 0.32 | 0.37 | 0.43 | 0.48 | 0.54 | 0.59 | 0.65 | 0.71 | 0.77 | 0.83 | | | | |
| 65 | 20 | 0.35 | 0.41 | 0.46 | 0.51 | 0.57 | 0.63 | 0.69 | 0.75 | 0.81 | | | | | |
| | 24 | 0.27 | 0.32 | 0.37 | 0.43 | 0.48 | 0.54 | 0.59 | 0.65 | 0.71 | | | | | |
| 60 | 20 | 0.30 | 0.35 | 0.41 | 0.46 | 0.51 | 0.57 | 0.63 | 0.69 | | | | | | |
| | 24 | 0.23 | 0.27 | 0.32 | 0.37 | 0.43 | 0.48 | 0.54 | 0.59 | | | | | | |
| 55 | 20 | 0.26 | 0.30 | 0.35 | 0.41 | 0.46 | 0.51 | 0.57 | | | | | | | |
| | 24 | 0.18 | 0.23 | 0.27 | 0.32 | 0.37 | 0.43 | 0.48 | | | | | | | |
| 50 | 20 | 0.21 | 0.26 | 0.30 | 0.35 | 0.41 | 0.46 | | | | | | | | |
| | 24 | 0.14 | 0.18 | 0.23 | 0.27 | 0.32 | 0.37 | | | | | | | | |
| 45 | 20 | 0.16 | 0.21 | 0.26 | 0.30 | 0.35 | | | | | | | | | |
| | 24 | 0.13 | 0.17 | 0.22 | 0.26 | 0.31 | | | | | | | | | |
| 40 | 20 | 0.10 | 0.14 | 0.18 | 0.23 | 0.27 | | | | | | | | | |
| | 24 | 0.12 | 0.16 | 0.21 | 0.26 | | | | | | | | | | |
| 35 | 20 | 0.06 | 0.10 | 0.14 | 0.18 | | | | | | | | | | |
| | 24 | 0.08 | 0.12 | 0.16 | | | | | | | | | | | |
| 30 | 20 | 0.03 | 0.06 | 0.10 | | | | | | | | | | | |
| | 24 | 0.05 | 0.08 | | | | | | | | | | | | |

The indicated outputs with ΔT 50°C and ΔT 30°C are the exact outputs. ΔT 50°C outputs are measured in accordance with EN442 and ΔT 30°C outputs are calculated according to EN442.

An average correction factor is given in this table for outputs at other ΔT and is applicable for all dimensions.

KEY
 Tv = flow temperature
 Tr = return temperature
 Tl = desired air temperature

How to choose the right radiator?

Rapid estimation of heat losses

Calculate the volume of the room (L x W x H) and multiply this by the Watts/m³ figure given in the table below. Choose according to the level of insulation and the desired room temperature.

| Insulation | 20° | 24° |
|------------|-----|-----|
| excellent | 45 | 55 |
| good | 65 | 75 |
| average | 85 | 95 |
| poor | 100 | 115 |

Required output in Watts/m³

Example

Use the table to determine the relevant correction factor with a water temperature of 80/60°C with a room temperature of 24°C.


The correction factor = **0.90**

Required output 1000 watts : 1000 divided by 0.90 = 1111 watts therefore search in this leaflet's standard output table for a product with an output of at least 1111 watts. Alternatively use the "Radiator Finder" search function on www.jaga.co.uk to identify all Jaga heating products with this required output.



Output calculated in accordance with EN442, at a water temperature of 75/65°C and a room temperature of 20°C ($\Delta T=50$).

Pressure drop

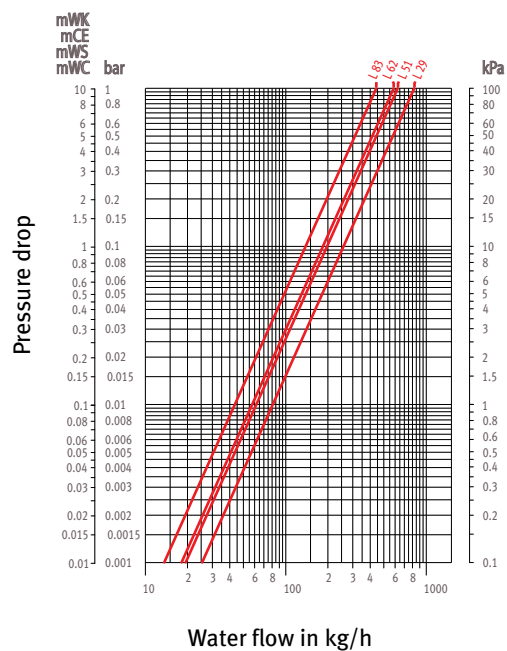

Weight & water content

Weight in kg

| H | L | 510 | 620 | 730 |
|------|---|------|------|------|
| 1800 | | 28.7 | 33.8 | 39.0 |
| 1920 | | 30.4 | 35.9 | 41.4 |
| 2000 | | 31.6 | 37.3 | 43.0 |
| 2200 | | 34.5 | 40.8 | 47.0 |
| 2400 | | 37.7 | 44.4 | 51.3 |

Weight content in litres

| H | L | 510 | 620 | 730 |
|------|---|------|------|------|
| 1800 | | 10.2 | 12.0 | 13.9 |
| 1920 | | 10.8 | 12.8 | 14.8 |
| 2000 | | 11.2 | 13.3 | 15.4 |
| 2200 | | 12.3 | 14.6 | 16.8 |
| 2400 | | 13.4 | 15.8 | 18.3 |

Product description

Iguana Visio

Material

Consists of vertical triangular steel radiation pipes, welded on steel positioning brackets. The radiation pipes are hydraulically connected using steel bends. Suitable for central heating.

Finish

The radiators are sandblasted, degreased, phosphated, electrostatically lacquered with epoxy-polyester powder and finally stove enamelled at 200 °C. This high quality finish offers an optimal scratch resistance and is very easy to maintain.

Thickness of the lacquer: min 80 µ

Pressure test: 9 bar

Working pressure: 6 bar

Colour

The radiator is lacquered in the colour sandblast grey metallic 001 / white (RAL 9010) / white (RAL 9016) / other (see colour chart)

The Iguana Visio consists of triangular vertical radiation pipes welded on steel positioning brackets. The radiation pipes are hydraulically connected using steel bends, placed next to each other in a curved line with an open space in which a rectangular mirror in the full length of the radiator has been placed. Mirror with a cut edge all around, dimensions 260mm x 1790mm. Supplied with wall brackets and 2 air vents G 1/8 inch. Central connection, standard for 2 pipe.

Options

All options have the same radius as the radiator. They can also be ordered and fitted afterwards.

- Towel rail and fixings in chrome-plated aluminium.
- Hat rack and fixings in chrome-plated aluminium. Including 5 coat hooks.
- Small shelf in beech veneer with chrome-plated fixings. Shelf width: 100mm.
- Large shelf in beech veneer with chrome-plated fixings. Shelf width: 170mm.
- Deco connection sets and valves 2 pipe.
- Deco Pro connection sets and valves 2 pipe.
































How to install

The building services engineer chooses the heating elements considering the following conditions:

- A heat output calculation according to the standard.
- Tables of heat outputs and dimensions for Iguana Visio radiators according to EN 442.
- The radiators will be mounted to the wall with accessory brackets.
- The specially designed thermostatic connection sets / thermostatic Jaga Deco / Jaga-Pro valves / manual Jaga Deco valves can be connected to plastic central heating service pipes / RPE/ALU. tube / copper tube/ steel pipe.
- Jaga thermostatic heads / Jaga Deco thermostatic heads chrome / Jaga Deco thermostatic heads chrome/ white / Jaga Comap thermostatic heads silver / not to be / to be fitted.

Jaga colours

For Iguana Visio

| | | |
|--|--|--|
|  201 301 White |  212 312 Bahama |  222 322 Capri |
|  202 302 Off-white |  213 313 English Green |  223 323 Natural |
|  203 303 Light Grey |  214 314 Whisper Rose |  224 324 Edelweis |
|  204 304 Black |  215 315 Turquoise |  225 325 Jasmine |
|  205 305 Pergamon |  216 316 Bermuda |  226 326 Ruby Red |
|  206 306 Manhattan |  217 317 Chocolate Brown |  228 328 Classic White |
|  208 308 Sapphire Blue |  218 318 Azure |  229 329 Patina Green |
|  209 309 Dark Grey |  219 319 Violet |  230 330 Aloa Blue |
|  210 310 Golden Yellow |  220 320 Aegean |  231 331 Anthracite Grey |
|  211 311 Flaming Red |  221 321 Calypso |  232 332 Sunrise |
| | |  233 333 Traffic White |

Special Colours

| |
|--|
|  001 Sandblast Grey Metallic |
|  002 Hammerstroke Silver/Black |
|  003 Claret Metallic |
|  005 Smooth Grey Metallic |
|  006 Aluminium |
|  007 Anthracite Metallic |
|  008 Anthracite Structure |

As it's impossible to reproduce colours with 100% accuracy, this colour chart is intended as a guide only. Colour swatches are available on request.

Jaga Guarantee Information

- 1** The guarantee is valid only if the equipment is properly and correctly used, by its first owner and if installed in accordance with the norms and instructions as detailed in the instruction leaflet and current industry standard practices.
- 2** The guarantee only applies to the equipment and the spare parts supplied by Jaga. Jaga has the choice between repair and replacement of the equipment or the spare parts. If any modifications have been made by Jaga to the standard product design, Jaga reserves the right to replace the guaranteed equipment with equivalent products or spare parts.
- 3** The period of guarantee is mentioned in this certificate. The guarantee decreases every year on a straight line basis by an equal percentage in order to reach a zero guarantee at the end of the guarantee period (e.g. for a period of 10 years the annual decrease of the guarantees 10% of the invoiced value). Repaired or replaced product is guaranteed through to the end of the original guarantee period.
- 4** The guarantee is valid only on products displaying the appropriate identification information concerning product type and series. No guarantee is granted on equipment or spare parts lacking this information, on equipment where this information has been removed or altered, or on equipment that has been repaired or modified by persons not authorised by Jaga to carry out this work.
- 5** The customer is responsible for any damage caused as a result of errors in installation or use of incorrect fittings, or for any damage caused by electrical connections, faulty or damaged electrical installations or appliances, erroneous voltage or hydraulic pressure and all other errors not directly related to the product delivered by Jaga. The guarantee is also revoked when unsuitable parts or components are used. The guarantee for our heat exchangers is not valid if they are regularly drained, or if they are heated by means of industrial water, steam or water saturated by excessive quantities of oxygen. The quality of the system after has to be in accordance with the VDI 2035-2 directives. The guarantee is also not applicable if the heat exchangers are placed in unsuitable atmospheric surroundings, such as but not exclusively ammonia, caustic substances etc.
- 6** This guarantee excludes damage due to incorrect handling and/or use of the equipment, or due to formation of lime deposits, incorrect use of the safety valve, or to all equipment that is incorporated into the building in a way that means it cannot be accessed normally.
- 7** Any work undertaken or product supplied as a result of a guarantee claim that proves not to be valid will be charged for. Product supplied will be invoiced at the customer's standard purchasing terms, and labour will be charged at £50 per hour with a minimum labour charge of £200.
- 8** The guarantee period starts from the date of the invoice for supply of the products covered by the guarantee. If the invoice is not available, the date of production will be used based on the product ID number/series.
- 9** Only the courts of judicial district Hasselt (Belgium) are authorised to deal with disputes arising from this guarantee. It will apply Belgian law even when sales involved are subjects of EU member states as well as non-EU member countries.

Casings and components



Valves for Low-H2O heat exchangers

